PolyGard® Single Point Controller SPC 63-1181

Single Point Gas Controller for Chlorine Dioxide

Serial Number _E_

User Manual

January 2015

PolyGard is a registered trademark of MSR

GASPC631181_E_0115

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice
Printed in Germany

1 Intended Use 4
1.1 Normal Mode 4
1.2 Alarm Mode 4
1.3 Fault Mode 4
2 Operating Instruction 5
2.1 Description Keypad User Interface 5
2.2 Setting / Changing Parameters or Set points 5
2.3 Code Levels 6
3 Menu Overview 7
3.1 Fault Management 8
3.1.1 Acknowledge a Fault 8
3.1.2 Error Memory 8
3.1.3 System Errors 9
3.2 Status Alarm 9
3.3 Status Relay 10
3.3.1 Manual Operation of the Relays 10
3.4 Menu Measuring Values 11
3.5 Menu Relay Parameters 11
3.5.1 Relay Mode 12
3.5.2 Relay Function Static / Flash 12
3.5.3 Latching Mode 12
3.5.4 Horn Function 13
3.5.5 External Relay Operation 14
3.5.6 Delay Mode of the Relay 14
3.6 Menu MP Parameters 14
3.6.1 Activate – Deactivate MP 16
3.6.2 Selection Gas Type 16
3.6.3 Measuring Range 17
3.6.4 MP Signal 17
3.6.5 Threshold / Hysteresis 17
3.6.6 Delay of Alarm ON or OFF 17
3.6.7 Control Mode 18
3.6.8 MP Fault Assigned to Alarm 18
3.6.9 Alarm Assigned to Alarm Relay 18
3.6.10 MP Signal Assigned to Analog Output 18
3.7 Menu System Parameters 19
3.7.1 Service Mode 20
3.7.2 Software Version 20
3.7.3 Maintenance Concept 20
3.7.4 Average Function 20
3.7.5 Customer Password (Code 4) 21
3.7.6 Analog Output 21
3.7.7 Define the Failure Relay 21
3.7.8 Power On Time 21

PolyGard is a registered trademark of MSR

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

4 Mounting / Electrical Connection 22
4.1 Electrical Connection 22
4.2 Connection Diagram 23
4.3 Connector Block / Overview SPC-53 Module 24
5 Commissioning 25
5.1 Commissioning 25
5.2 Checklist Commissioning 26
6 Configuration and Parameter Card 27
6.1 Configuration Card of System Parameters 27
6.2 Configuration Card of Alarm Relays 27
6.3 Configuration Card of Measuring Parameters 27
7 Specifications SPC-X3 28
8 Gas Sensor 30
8.1 Description 30
8.2 Calibration 30
8.2.1 Zero-Point Calibration 30
8.2.2 Gain Calibration 31
9 Inspection and Service 31
9.1 Inspection 31
9.2 Service and Calibration 31
9.3 Exchange of Sensor Element 31
10 Specification Gas Sensor 32
11 Part Disposal 33
12 Notes and General Information 33
12.1 Intended Product Application 33
12.2 Installers` Responsibilities 33
12.3 Maintenance 33
12.4 Limited Warranty 33

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

Single Point Gas Controller SPC-63

1 Intended Use

The PolyGard® SPC-63 Gas Controller is used for measuring, monitoring and warning of chlorine gases in the ambient air. The Gas Controller is provided with an internal gas sensor (MP01) for CLO_2. In addition an external gas transmitter (MP02) can be connected to the controller for controlling toxic or combustible gases or even Freons. Four alarm thresholds are free adjustable for each Measuring Point (MP). Every alarm threshold can be assigned to one of the maximum 4 alarm outputs (RX). The Gas Controller can interface via the (0)4 to 20 mA or (0)2 to 10 V output signal with any compatible electronic analog control, DDC/PLC control or automation system.

The free adjustable parameters and alarm threshold make a very flexible use in the gas measuring possible. Simple and comfortable commissioning is possible due to factory adjusted parameters.

The configuration parameter settings and operation is easy to do without programming knowledge.

The intended sites within the ambient conditions as specified in the Technical Data are all areas being directly connected to the public low voltage supply, e.g. residential, commercial and industrial ranges as well as small enterprises (according to EN50 082).

The PolyGard® Single Point Gas Controller SPC-63 must not be used in potentially explosive atmospheres.

1.1 Normal Mode

In normal mode, the gas concentrations of the active transmitters are continuously polled and displayed at the LCD display in a scrolling way. The controller also monitors the communication to all active transmitters.

1.2 Alarm Mode

If the gas concentration reaches the programmed alarm threshold, the alarm is started, the assigned alarm relay is activated and the red alarm LED is flashing. The set alarm can be read from the menu Alarm Status. When the gas concentration falls below the alarm threshold, the alarm in automatically reset. In latching mode, the alarm has to be reset manually in the menu Relay Status.

1.3 Fault Mode

If the controller detects an analog signal outside the admissible range (< 3 mA - > 22 mA) from an active transmitter, the assigned fault relay is set and the error LED is blinking. The error is displayed in the menu Error Status in clear text. After removal of the cause, the error message is acknowledged in the menu Error Status.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

2 Operating Instruction

The complete configuration, parameterization and service are made via keypad user interface in combination with the display screen. Security is provided via two password levels.

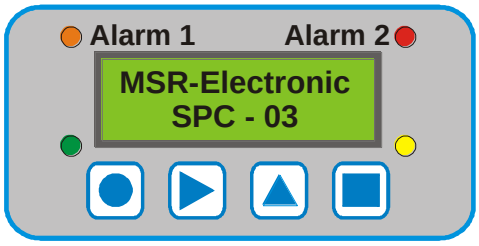

2.1 Description Keypad User Interface

Exits programming, returns to the previous menu level.

Enters submenus, save settings.

Scrolls up in main menu and submenus, increases or decreases a value.

Moves the cursor.

LED orange: Flashes when alarm one or more alarms are active.
Permanently on, when at least one of the relays is manually operated.

LED red: Flashes when alarm two or more alarms are active.
Permanently on, when at least one of the relays is manually operated.

LED yellow: Flashes at system or sensor failure or when maintenance needed.

LED green: Power LED

2.2 Setting / Changing Parameters or Set points

Open desired menu window.

Code window opens, if no code level approved.

After inputting the valid code the cursor jumps on the first position segment to be changed.

Push the cursor onto the position segment, which is to be changed.

Change the parameter / set point.

Save the changed value.

Finish

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

2.3 Code Levels

All inputs and changes are protected by a four-digit numeric code (= password) against unauthorised intervention. All menu windows are visible without entering a code.

Level 1: (1234)
Code level 1 allows the operator to acknowledge alarms and to manually activate the alarm relays.

Level 2:
Code level 2 is intended for the service technician to change parameters and set-points.

Level 3:
With code level 3 it is possible to register and deregister transmitters in addition to code level 1. This code is released by MSR-E only in emergency situations.

Level 4:
Code level 4 is intended for updating the maintenance date. Normally the code is only known by the service technician and can be changed individually via code level 2.

The release of a code level is cancelled if no button is pushed within 15 minutes.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3 Menu Overview

The operation of the Single Point Gas Controller SPC-X3 is effected by a simple and logical menu structure which is easy to learn.

The operating menu contains the following levels:

- Starting menu. Scrolling of the measuring points of all registered transmitters in 10-second intervals
- Main menu
- Submenu 1 and 2

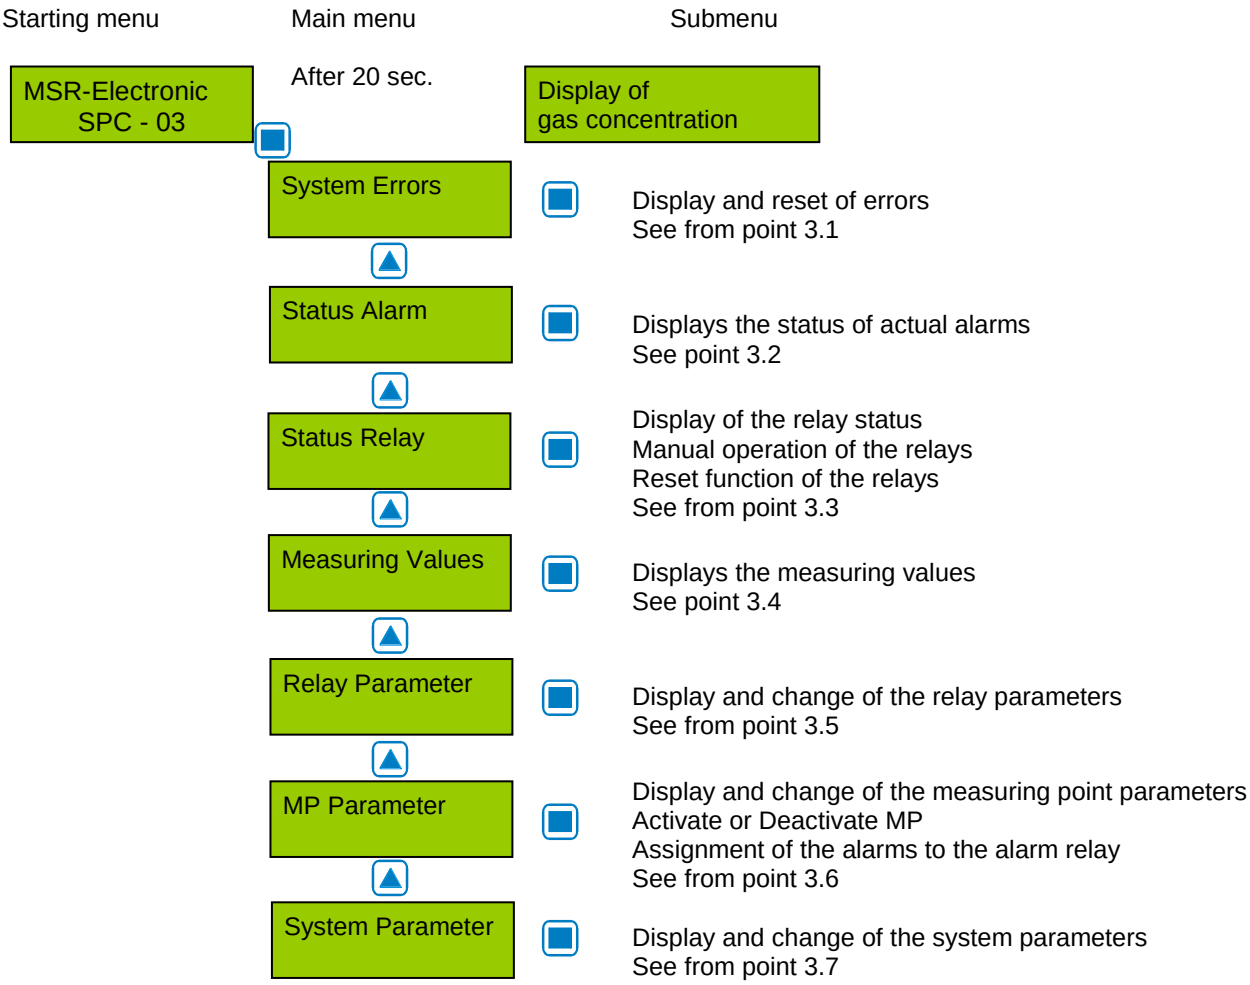

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.1 Fault Management

The integrated fault management records the last 15 faults in the menu “System Errors” with a stamp indicating how many days the error has already existed. The day counter subtracts “active ones” from 365. Additionally a record of the faults occurs in the “Error Memory”, which can be selected and reset only by the service technician.

An actual fault is displayed in plain text in the starting menu. The failure relay which is defined in the system parameter “Failure relay“ is activated. The yellow LED in the front of the gas controller flashes.

In case of fault of a measuring point (MP) the alarms defined in the menu “MP Parameter” are activated additionally.

3.1.1 Acknowledge a Fault

Attention:
Acknowledging a fault is only possible after having removed the cause.

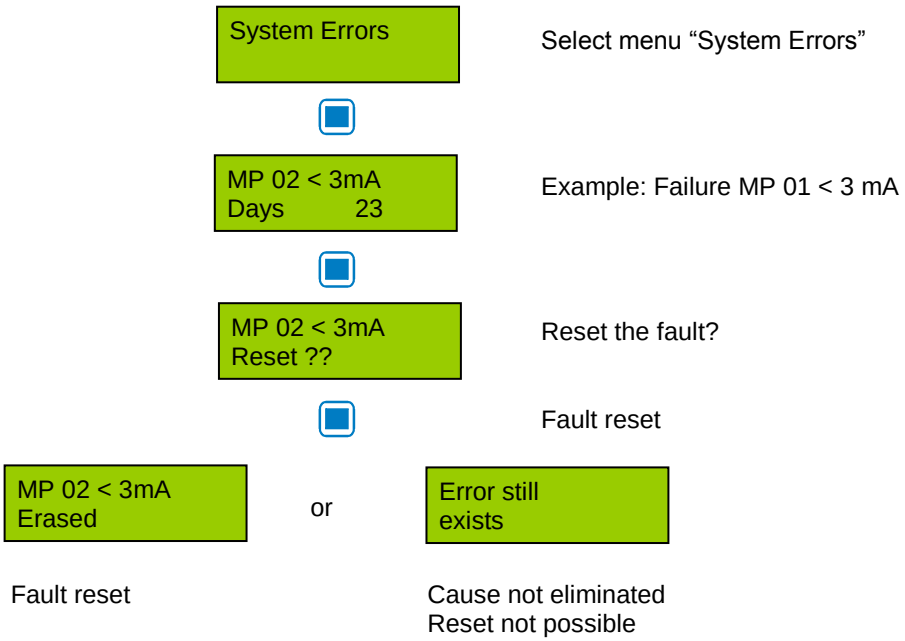

3.1.2 Error Memory

The menu “Error Memory“ in the main menu “System Error” can only be opened via code level 2.

In the error memory the last 15 faults are listed for the service technician even if they were already acknowledged in the menu “System Error“. The deletion of each individual message is effected in the same way as the reset of a fault.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de
Specification subject to change without notice.
Printed in Germany

3.1.3 System Errors

The following system error messages are recorded:

MP 02 > 22 mA Current signal at analog input > 22 mA / 11 VDC. (External Transmitter)

Cause: Short-circuit at analog input or transmitter not calibrated, transmitter defective.

Solution: Check cable to transmitter, make calibration, replace the transmitter.

MP 02 < 3 mA Current signal to analog input < 3 mA / 1,3 VDC. (External Transmitter)

Cause: Wire breaking at analog input or transmitter not calibrated, transmitter defective.

Solution: Check cable to transmitter, make calibration, replace the transmitter.

GC Error: Internal communication error I/O Board to LCD Board.

Cause: Internal error.

Solution: Change the Gas Controller module.

Maintenance: System maintenance is necessary.

Cause: Maintenance date exceeded.

Solution: Make the maintenance.

3.2 Status Alarm

Display of the actual alarms in plain text in the order of their arrival. Only those measuring points are displayed, where at least one alarm is active. Changes are not possible in this menu.



Symbol	Description	Function
MP 01	Measuring (MP) Point No.	
AX	Status alarm	A1 = Alarm 1 ON A2 = Alarm 2 ON A3 = Alarm 3 ON A4 = Alarm 4 ON

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.3 Status Relay

The SPC-53 has two alarm relays (R01 / R02) and two open collector outputs (R03 / R04). In the following description they are referred to as alarm relays.

Display of the actual status of alarm relays. Manual operation of the alarm relays.

Symbol	Description	Setting Status	Function
R 01	Relay No. 01		Select Relay No.
OFF	Status relay	OFF	OFF = Relay OFF (No gas alarm) ON = Relay ON (Gas alarm) Manual OFF = Relay manual OFF Manual ON = Relay manual ON

3.3.1 Manual Operation of the Relays

The manual operation of the alarm relays is managed in the menu “Status Relay”. If a relay is in the manual ON or OFF status, the orange/ red alarm LED at the Gas Controller is lit continuously.

The external operation of the alarm relay via an assigned digital input has priority to the manual operation in the menu "Status Relay" and to gas alarm.

Relays manually operated in the menu “Status Relay” are deleted again by selecting the function "Automatic".

Acknowledging the relays in latching mode is also effected in this menu.

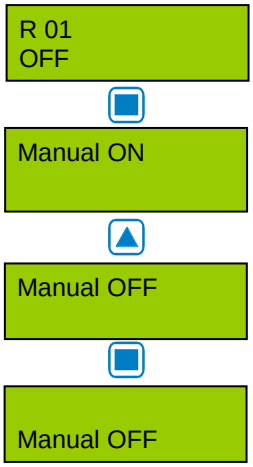

Select the relay

Select the function of manual operation

Select the function

Manual ON = Relay ON
Manual OFF = Relay OFF
Automatic = Delete manual operation.
Reset? = Reset of a latching mode.

Take over the function

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.4 Menu Measuring Values

This menu is for displaying the current value (CV) or the average value (AV) with gas unit and gas type for each active measuring point according to the defined mode of control (CV or AV mode). For gas type CO both values are displayed together.



Symbol	Description	Setting Status	Function
MP 01	Measuring P. No.		Selection of MP No
CLO_2	Gas type	CLO_2	See 3.6.2
ppm	Gas unit		See 3.6.2
CV	Current value	CV	Current value of gas concentration
AV	Average value		Average value (10 measured values within the time unit)
*	Control mode		Display of selected control mode (CV or AV)
Not active	Status MP	Not active	MP not active
Error	Fault MP		Current signal < 3 mA or > 22 mA

3.5 Menu Relay Parameters

Display and change of the parameters for each alarm relay

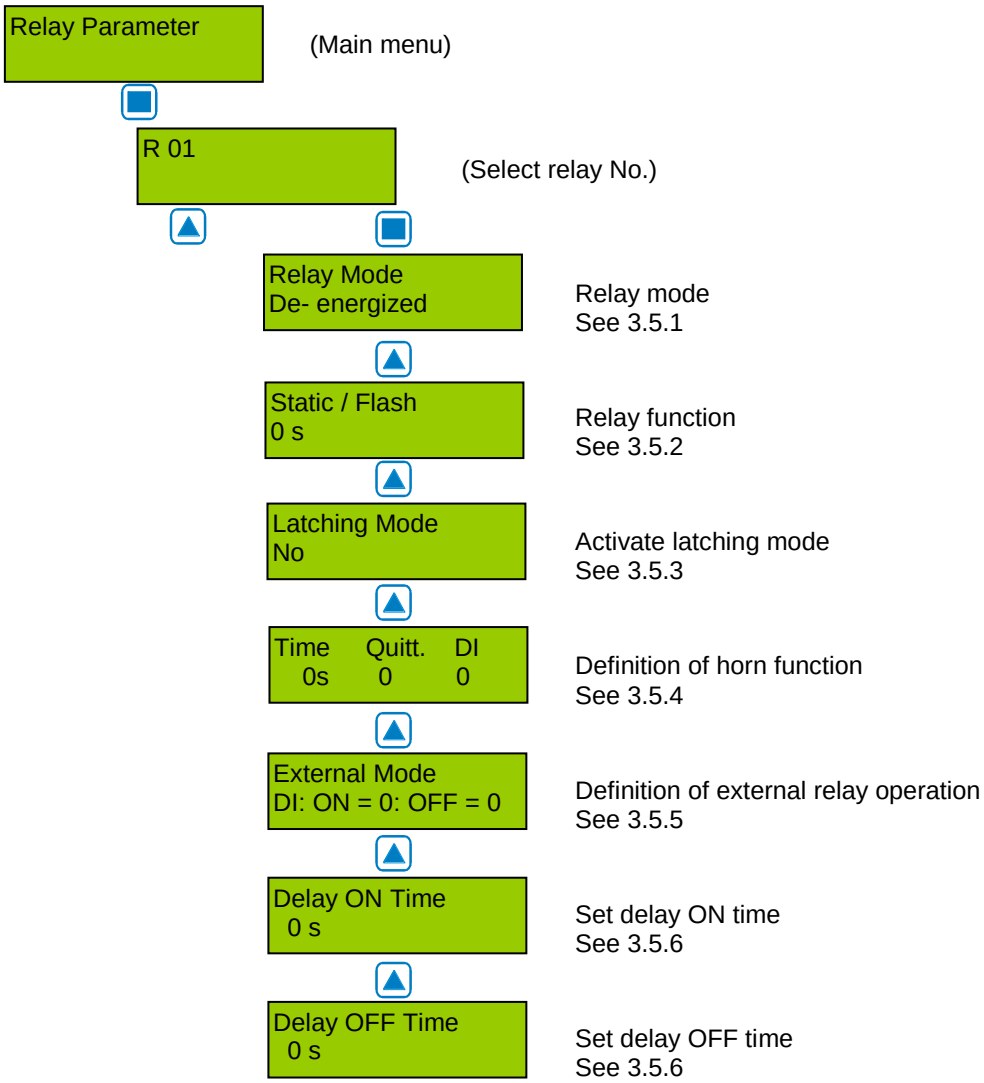

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.5.1 Relay Mode

Definition of relay mode:

Symbol	Description	Setting Status	Function
R 01	Relay No.		Selection of relay
De-energized	Relay Mode	De-energized	De-energized = Alarm ON = Relay ON Energized = Alarm ON = Relay OFF

3.5.2 Relay Function Static / Flash

Definition of relay function

Symbol	Description	Setting Status	Function
R 01	Relay No.		Selection of relay
0	Function	0	0 = Relay function static > 0 = Relay function flashing (= Time period in sec.) Impulse / Break = 1:1

3.5.3 Latching Mode

Definition of latching function

Symbol	Description	Setting Status	Function
R 01	Relay No.		Selection of relay
No	Latching Mode	No	No = Latching mode non active Yes = Latching mode active

Acknowledging a latching relay in the menu “Status Relay“ is only possible if the gas concentration is again lower than the alarm threshold including hysteresis. In this case the status latching occurs in the display.

Example: Alarm relay R2 with latching mode

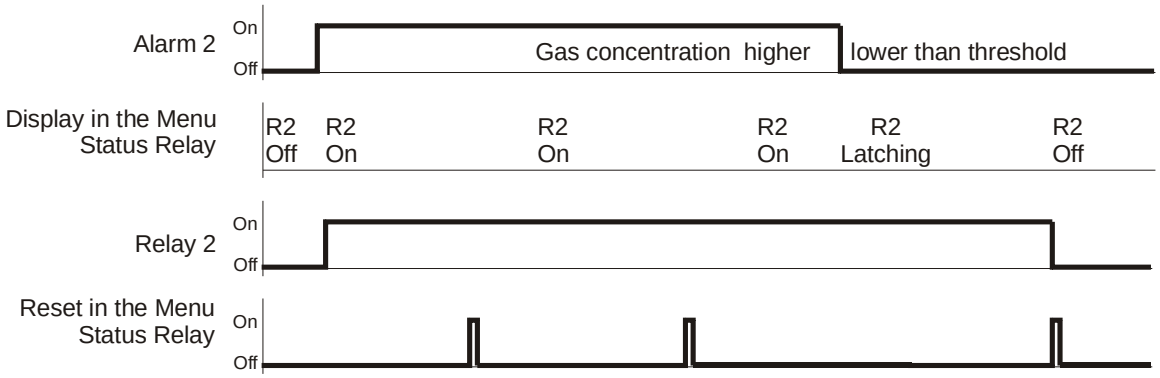

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.5.4 Horn Function

The internal horn is connected to alarm relay R3 (open collector).

This alarm output is defined as horn relay by this parameter with the following possibilities to reset.

- By pressing any of the 4 push-buttons (only possible in the starting menu).
- Automatic reset at the end of the fixed time.
- By an external push-button (assignment of the digital input).

The horn function is only activated if at least one of the two parameters (time or digital input) is set.

Special function Response

After acknowledging the output (by push-button or externally) time starts. When this time has run out and the alarm is still acting, the relay is set again.

Symbol	Description	Setting Status	Function
R 03	Relay No.		Selection of relay
Quitt	Mode	0	0 = Reset of the relay after time having run out, or by push-button 1 = Reset of the relay by push-button, after time having run out and when alarm is still acting, relay is set again. (Response function).
Time		120	Time for automatic reset function or response function 0 = no reset function
DI		0	Assignment, which digital input resets the output.

Acknowledge the horn output

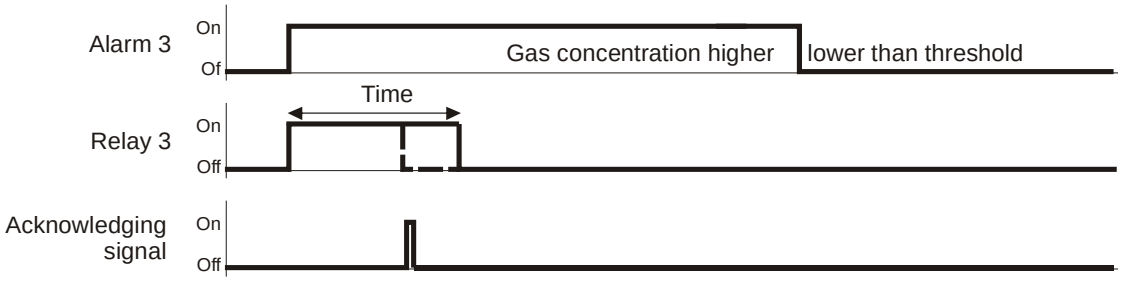

Special function „Response“. (Return of the horn relay)

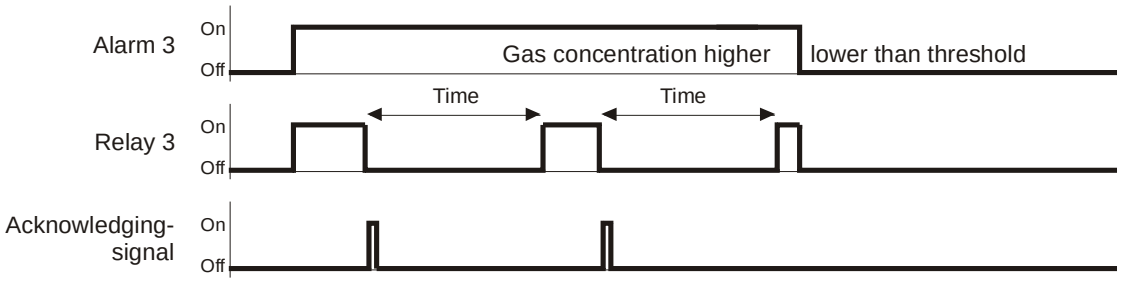

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.5.5 External Relay Operation

Assignment of the digital input (DI) for external switching of the alarm relay (ON and/or OFF). This function has priority to gas alarm and/or manual switching in the menu “Status Relay“.

Symbol	Description	Setting Status	Function
R 01	Relay No.		Relay Selection
DI-ON	External On	0	If digital input closed, relay switches ON
DI-OFF	External Off	0	If digital input closed, relay switches OFF

3.5.6 Delay Mode of the Relay.

Delay time ON starts when the alarm is released and/or delay time OFF starts when the alarm returns to normal condition.

Symbol	Description	Setting Status	Function
R 01	Relay No.		Relay Selection
0 s	Delay Time ON	0	Mode ON: Relay is only activated at the end of the defined time (sec.) 0 sec. = No delay
0 s	Delay Time OFF	0	Mode OFF: Relay is only deactivated at the end of the defined time (sec.) 0 sec. = No delay

3.6 Menu MP Parameters

Display and change of parameters, assignment of alarms to alarm relays and activation of Measuring Points (MP).

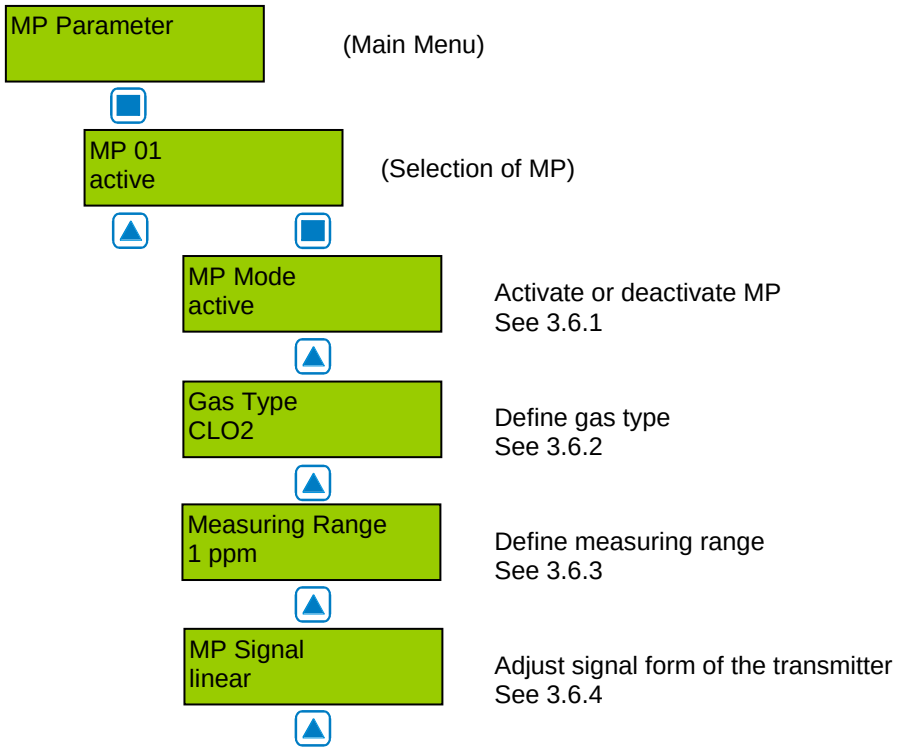

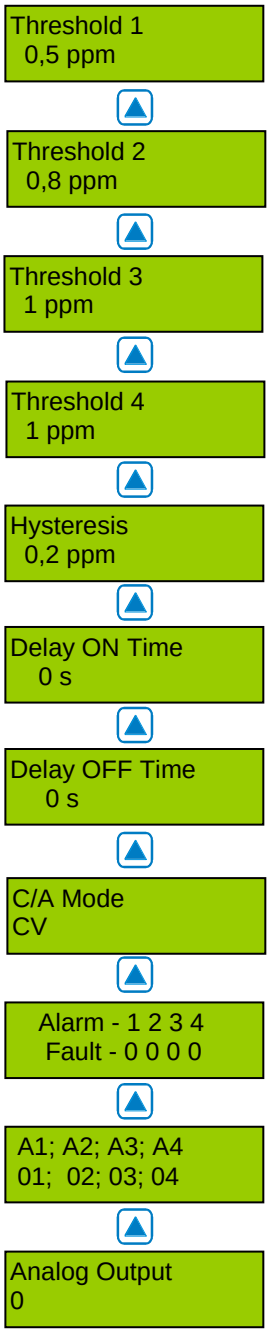

Define threshold 1
See 3.6.5

Define threshold 2
See 3.6.5

Define threshold 3
See 3.6.5

Define threshold 4
See 3.6.5

Hysteresis
See 3.6.5

Set delay ON time
See 3.6.6

Set delay OFF time
See 3.6.6

Define control mode
See 3.6.7

Assign MP fault to alarm
See 3.6.8

Assign alarm to alarm relay
See 3.6.9

Assign MP signal to analog output
See 3.6.10

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.6.1 Activate – Deactivate MP

Symbol	Description	Setting Status	Function
MP 01*	Measuring point		Selection MP No.
Active	MP Status	Not active	Active = Measuring point activated at the controller Not active = Measuring point not activated at the controller

*MP01 = On Board sensor
*MP02 = Externer Transmitter (optional)

3.6.2 Selection Gas Type

Assign gas type to attached gas transmitters.

Symbol	Description	Setting Status	Gas type		Unit	Measuring range[1]
MP 01	Measuring point					
CL_2	Gas type	CL_2	CO	Carbon monoxide	ppm	0 – 300
			O2>	Oxygen (increasing)[2]	Vol%	0 – 25
			O3	Ozone	ppm	0 – 5
			TOX	Toxic gas	ppm	0 – XX
			CO2	Carbon dioxide[4]	ppk	0 – 50
			RH	Humidity	% RH.	0 – 100
			Temp.	Temperature	° C	0 – 50
			R22	Refrigerant gas	ppm	0 – 2000
			R134	Refrigerant gas	ppm	0 – 300
			R123	Refrigerant gas	ppm	0 – 300
			R11	Refrigerant gas	ppm	0 – 300
			R411	Refrigerant gas	ppm	0 – 300
			R410	Refrigerant gas	ppm	0 – 300
			R407	Refrigerant gas	ppm	0 – 300
			R416	Refrigerant gas	ppm	0 – 300
			R404	Refrigerant gas	ppm	0 – 300
			R409	Refrigerant gas	ppm	0 – 2000
			R408	Refrigerant gas	ppm	0 – 2000
			R402	Refrigerant gas	ppm	0 – 2000
			R401	Refrigerant gas	ppm	0 – 2000
			VOC	Air quality	ppm	0 – 2000
			ETC	Ethylene oxide	ppm	0 – 20
			Cl2	Chlorine	ppm	0 – 100
			H2S	Hydrogen sulphide	ppm	0 – 200
			SO2	Sulphur dioxide	ppm	0 – 100
			Ex	Carbon dioxide[5]	ppm	0 – 2000
			O2<	Oxygen (falling)[3]	Vol%	0 – 25
			NH3	Ammonia	ppm	0 – 300
			NO2	Nitrogen dioxide	ppm	0 – 25
			NO	Nitrogen oxide	ppm	0 – 50
			Ex	Combustible gas	%LEL	0 – 100

[1] Recommendation without obligation
[2] Oxygen measurements: Alarm at increasing concentration
[3] Oxygen measurements: Alarm at falling concentration
[4] Carbon dioxide measurements with unit ppk (1 vol% = 10 ppk)
[5] Carbon dioxide measurements with unit ppm (1 vol% = 10.000 ppm)

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de
Specification subject to change without notice.
Printed in Germany

3.6.3 Measuring Range

The measuring range can be defined arbitrarily between 1 and 10000. The measuring ranges in the table gas type are only recommendations without obligation.

The measuring range for MP01 (inside toxic sensor) is factory set, the measuring range for MP02 must agree with the signal (4 to 20 mA / (0)2 to 10 V) of the attached gas transmitter.

(4 mA / (0)2 V = Display 0 (ppm); 20 mA / 10 V = Display of the ultimate value of the measuring range)

3.6.4 MP Signal

Gas transmitters using electro-chemical or catalytic beat gas sensors normally produce a linear 4 to 20 mA / (0)2 to 10 V signal, proportional to the gas concentration.

Semiconductor gas sensors produce a non-linear (exponential) signal. This signal leads to a non-linear 4 to 20 mA / (0)2 to 10 V signal of the gas transmitter.

The Single Point Gas Controller SPC-X3 is prepared for gas transmitters with linear signal as well as for µGard analog transmitters with semiconductor sensor and non-linear signal. The classification of signals is defined in this menu.

Symbol	Description	Setting Status	Function
MP 01	Measuring Point		Selection of MP No.
Linear	MP Signal	Linear	Linear = Transmitter with linear output signal Non-linear = Transmitter with non-linear output

3.6.5 Threshold / Hysteresis

For each measuring point four alarm thresholds are available for free definition. If the gas concentration is higher than the adjusted alarm threshold, the associated alarm is set. If the gas concentration falls below the alarm threshold inclusive hysteresis the alarm is again reset.

Unused alarm thresholds have to be defined at measuring range end point, in order to avoid false alarms.

For O_2 measurement: Pay attention to the alarm activation at decreasing or increasing concentration!

Symbol	Description	Default Status		Function
MP 01	Measuring Point			Selection MP No.
0,5 ppm	Threshold	0,5 0,8 1 1 0,2	Threshold 1 Threshold 2 Threshold 3 Threshold 4 Hysteresis	Gas concentration > Threshold 1 = Alarm 1 Gas concentration > Threshold 2 = Alarm 2 Gas concentration > Threshold 3 = Alarm 3 Gas concentration > Threshold 4 = Alarm 4 Gas concentration < (Threshold X –Hysteresis) = Alarm X OFF

3.6.6 Delay of Alarm ON or OFF

Definition of alarm ON and/or alarm OFF delay. The function applies to all alarms of an MP.

Symbol	Description	Default Status	Function
MP 01	Measuring Point		Selection of MP No.
0 s	Delay Time ON	0	Gas concentration > Threshold: Alarm is only activated at the end of the fixed time (sec.). 0 sec. = No Delay
0 s	Delay Time OFF	0	Gas concentration < Threshold: Alarm is only deactivated at the end of the fixed time (sec.). 0 sec. = No Delay

The delayed activation of an existing gas alarm can cause damage to persons and objects.
The commissioning technician and/or the operator are solely responsible for the activation.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de
Specification subject to change without notice.
Printed in Germany

3.6.7 Control Mode

Definition of the alarm evaluation by means of current (CV) or average value (AV).

Symbol	Description	Default Status t	Function
MP 01	Measuring Point		Selection of MP No.
CV	Evaluation	CV	CV = Control by the current gas value AV = Control by the average gas value

Current- average value function see: 3.7.4

3.6.8 MP Fault Assigned to Alarm

Definition, which alarms are activated in case of a fault at the measuring point.

Symbol	Description	Default Status	Function
MP 01	Measuring Point		Selection of MP No.
Alarm - 1 2 3 4 Fault - 0 0 0 0	Failure MP	0 0 0 0	0 = Alarm not ON at MP failure 1 = Alarm ON at MP failure

3.6.9 Alarm Assigned to Alarm Relay

Each of the 4 alarms can be assigned to any alarm relay. Unused alarms are not assigned to any alarm relay.

Symbol	Description	Default Status	Function
MP 01	Measuring Point		Selection of MP No.
1	A1 A2 A3 A4	01 02 03 00	01 = Alarm 1 activates alarm relay R 01 02 = Alarm 2 activates alarm relay R 02 03 = Alarm 3 activates alarm relay R 03 00 = Alarm 4 doesn't activate any alarm relay

3.6.10 MP Signal Assigned to Analog Output

The measuring point signal can be assigned to the analog output. At this the signal defined in the control mode (current or average value) is transmitted.

Analog output see also: 3.7.7

Symbol	Description	Default Status	Function
MP 01	Measuring Point		Selection of MP No.
0	A	0	0 = MP Signal not assigned to analog output 1 = MP Signal assigned to analog output 1

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.7 Menu System Parameters

Displays and changes the system parameters of the Gas Controller module.

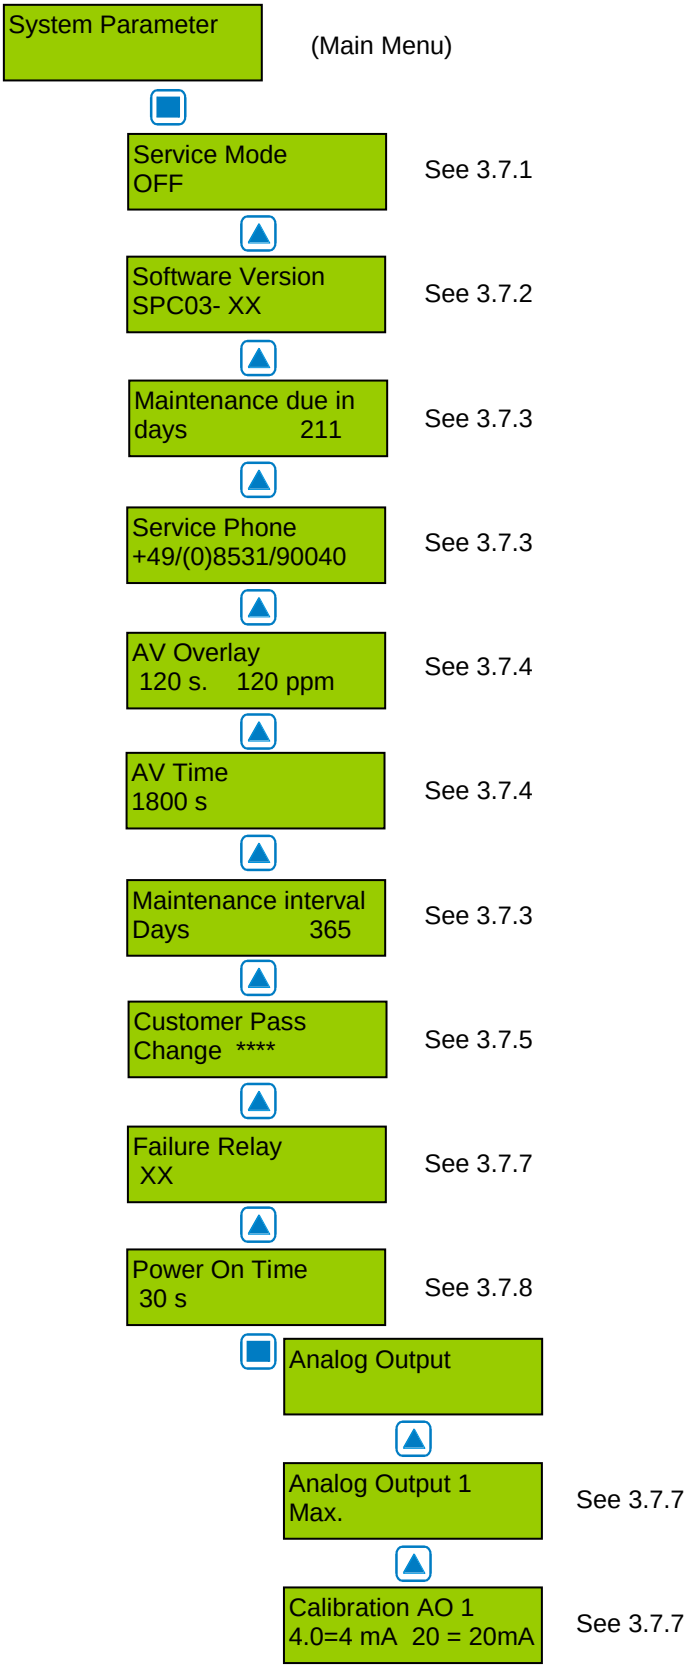

3.7.1 Service Mode

When the service mode is active (ON) the alarms are not transmitted to the alarm relays (in case of calibration or service work). The service mode is reset automatically after 60 minutes or manually in the menu “Service Mode”.

Symbol	Description	Default Status	Function
Off	Service Mode	Off	Off = Alarms activate the associated alarm relays On = Alarms are not transmitted to the alarm relays

3.7.2 Software Version

Symbol	Description	Default Status	Function
SPC03-XX	Software Version		XX = Software Version

3.7.3 Maintenance Concept

Integrated in the SPC-X3 system there is a control of the maintenance intervals required by law or by the customer. At commissioning or after maintenance the number of days until the next due maintenance is entered = Reset of the maintenance message (service phone no.). When the days counter reaches zero, the failure signal is activated the following morning at 9 o’clock, and the phone no. of the service technician occurs in the display. The remaining days until the next maintenance can be read from the menu “Maintenance in”.

The service phone no. can be entered individually in the next menu.

Symbol	Description	Default Status	Function
XXX	Maintenance in		Remaining days until the next maintenance
XXX	Maintenance interval	365	Reset of the maintenance message by entering the number of days until the next maintenance
0853....	Phone No.		Input of the individual service phone no.

3.7.4 Average Function

For each active measuring point the Single Point Gas Controller calculates the arithmetic average value out of 10 measurements got within the time unit defined in the menu “AV Time“. This average value is indicated in the menu “Measuring Values” next to the current value. At each measuring point the control mode (current or average value) is defined for the alarm evaluation.

The alarm evaluation of the control mode average value is overlaid by the current value, when the current value exceeds the alarm threshold defined in the menu “AV Overlay“. The overlay is delayed by the time factor defined in this menu. Whit time factor 0 sec. the overlay is not active.

Symbol	Description	Default Status	Function
120 s 120 ppm	AV Overlay	120 s 120 ppm	sec. = Delay time of average value overlay. 0 = No overlay function ppm = Alarm threshold of average overlay
1800 s	AV Time	1800 s	sec. = Time for the calculation of the average value

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

3.7.5 Customer Password (Code 4)

Change the system password for level 4

Symbol	Description	Default Status	Function
XXXX	Customer Password		XXXX = Definition of an individual 4-digit customer's password (level 4)

3.7.6 Analog Output

The Single Point Gas Controller has one analog output (AO01) with (0)4 to 20 mA / (0)2 to 10 V signal. The signal of MP01 or/and MP02 can be assigned to the analog output. The assignment is effected in the menu "MP Parameters" for each MP. The measuring point sends the signal, which is defined in the menu "C/A Mode".

The output signal (mA / V) and starting point (0 / 20%) is selected at the I/O Board by means of jumper. See fig. 5.

Out of the signals of all assigned measuring points the Single Point Gas Controller determines the minimum, the maximum or the average value and transmits it to the analog output. The definition, which value is transmitted, is effected in the menu "Analog Output 1".

The analog output can be calibrated at 4 and at 20 mA, only in mA mode. Therefore an ampere meter (measuring range 25 mA) can be attached to the AO and the respective factor has to be changed until the analog output corresponds to 4 and/or 20 mA. During calibration evaluation of the measuring point signals is not possible. This calibration is effected by the factory. The factors shall not be changed.

Symbol	Description	Default Status	Function
Max.	Select Output Mode	Max.	Min. = Displays the minimum value of all assigned MP Max. = Displays the maximum value of all assigned MP Average = Displays the average value of all assigned MP
4.0 20.0	Calibration	4.0 20.0	4. = Calibration factor at 4 mA 20.0 = Calibration factor at 20 mA

3.7.7 Define the Failure Relay

Definition of the failure relay. See also fault management (3.1)

Symbol	Description	Default Status	Function
X	Fault Relay	RX	RX = Define the fault relay

3.7.8 Power On Time

Gas sensors need a running-in period, until the chemical process of the sensor reaches stable conditions. During this running-in period the current signal can lead to an unwanted releasing of a pseudo alarm. Therefore the power on time is started at the SPC-X3 after having switched on the power supply. While this time is running out, the Gas Controller does not activate any alarms. The power on status occurs in the starting menu.

Symbol	Description	Default Status	Function
30 s	Power On Time	30 s	XX = Define the power on time (sec.)

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

4 Mounting / Electrical Connection

The Gas Controller is fixed to the wall through the mounting holes at the 4 corners of the housing. These mounting holes are accessible after opening the housing. If you use the mounting holes at the bottom part of the housing, the device loses the protection class IP 65.

We recommend considering the following when choosing the mounting place:

- Installation height. The specific weight of chlorinedioxide is higher than that of air (factor 2,3).
  Recommended installation height is 0.2 m (0,7 ft.) above floor.
- Cables are introduced from below.
- Keep a minimum distance of 150 mm on the right side in order to open the stainless steel housing.
- Customer's instructions.

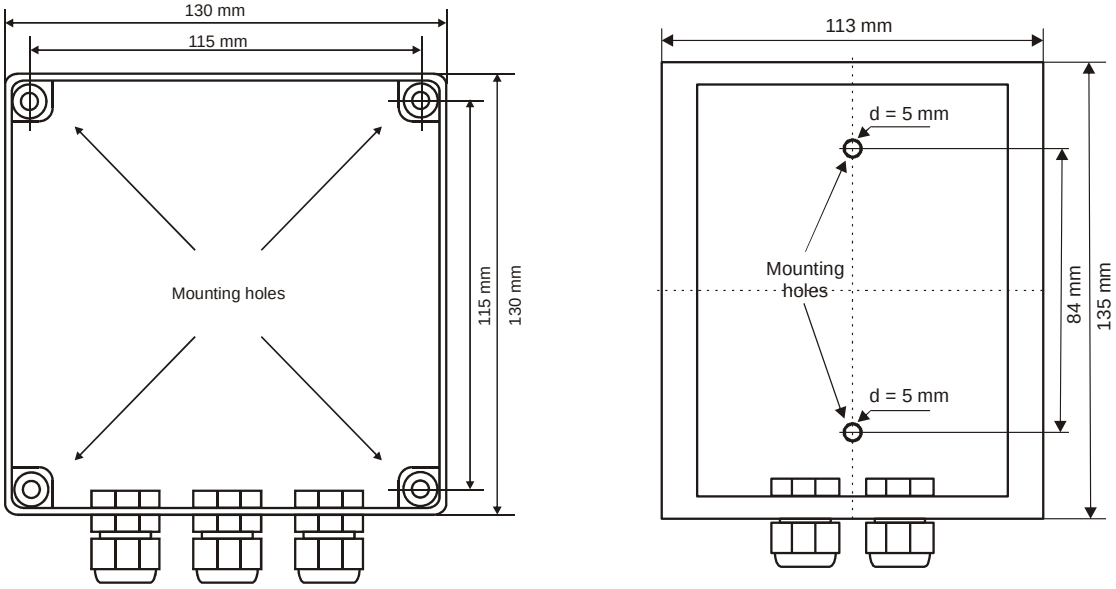

Fig. 01 Standard plastic housing Stainless steel housing

4.1 Electrical Connection

The technical requirements and regulations for wiring, electrical security, as well as project specific and environmental conditions etc. must be observed when mounting.

The electrical installation may only be completed by a qualified electrician in full compliance with pertinent regulations.

We recommend the following cable types[1]

- Power supply J-Y(St)Y 2x2 x 0,8
- Alarm relay J-Y(St)Y 2x2 x 0,8
- Gas transmitter J-Y(St)Y 2x2 x 0,8

[1] The recommendation does not consider local conditions such as fire protection etc.

For the exact position of the terminals see the following connection diagram.

When choosing the option "Power Supply" you have to make sure that a switch or a circuit breaker is provided in the building automation especially for the SPC. It must be installed easily accessible near the SPC. It has to be marked as a disconnecting device for the SPC. This switch or circuit breaker shall meet the relevant requirements of IEC 60947-1 and IEC 60947-3.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de
Specification subject to change without notice.
Printed in Germany

4.2 Connection Diagram

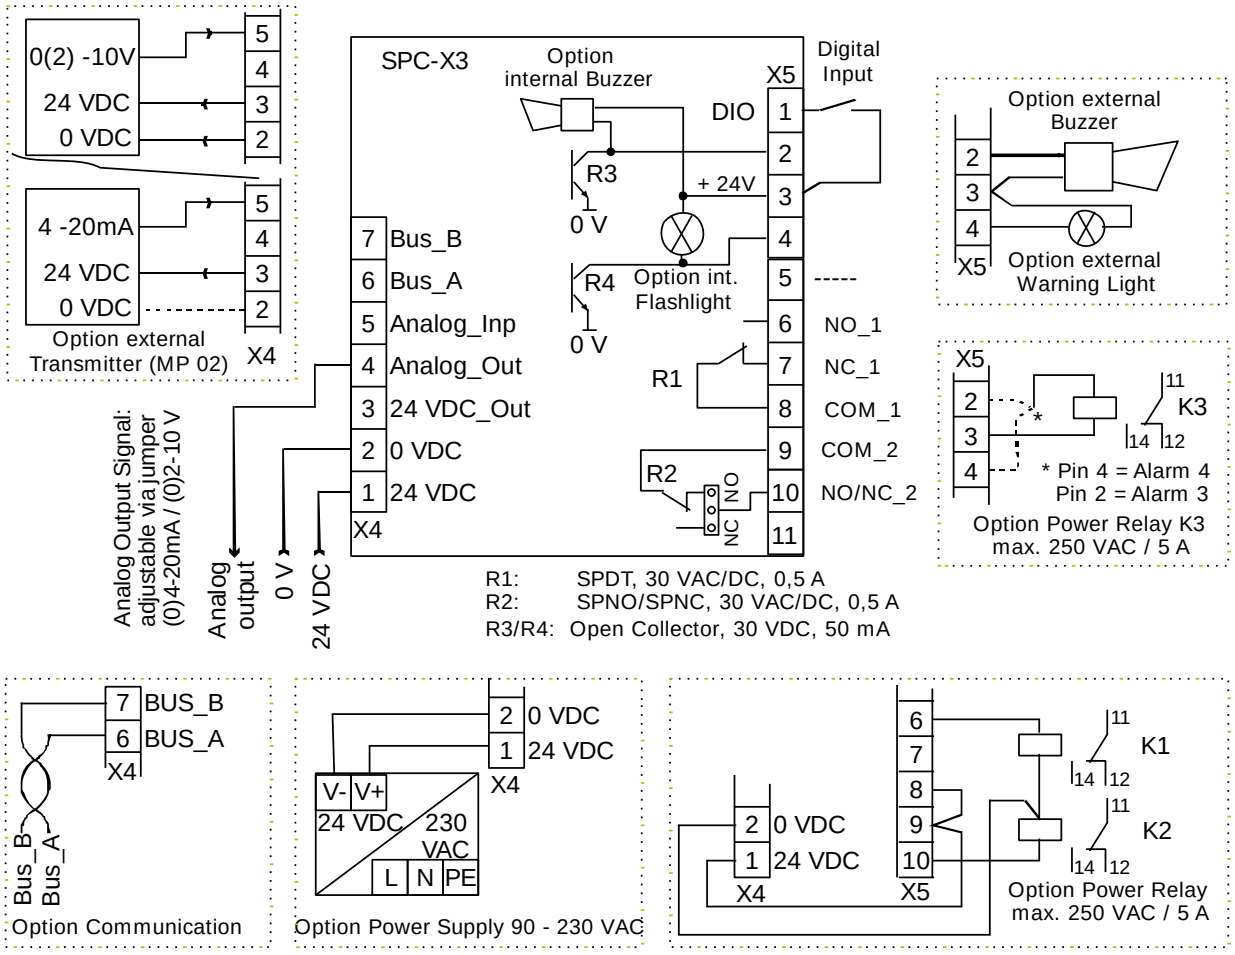

Fig. 2 Connection diagram

* The analog input function is determined by the hardware. Each PCB has got a label with the specific type. See fig. 4.

Note:

The alarm outputs R3 and R4 are designed as open collector outputs. Warning lamps / horn combination units with common ground can therefore not be connected!

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

4.3 Connector Block / Overview SPC-53 Module

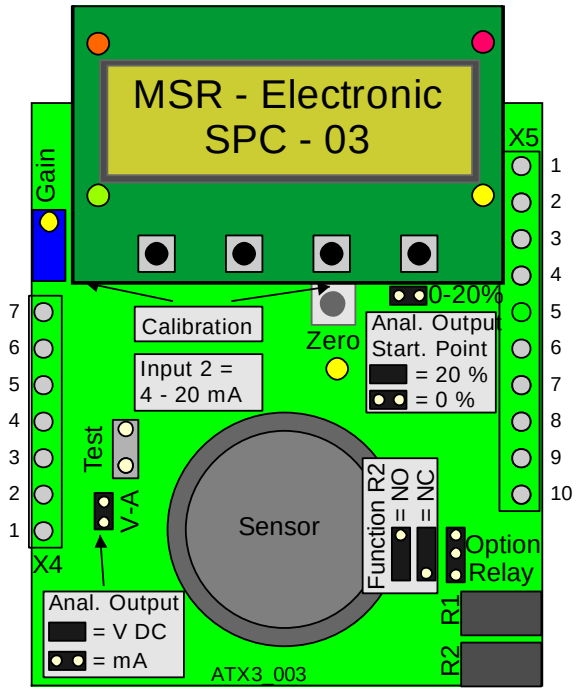

Fig. 3 PCB

Jumper 0- 20 %	Jumper V-A	Output signal
Not set	Not set	0 – 20 mA
Set	Not set	4 – 20 mA
Not set	Set	0 – 10 V
Set	Set	2 – 10 V

Fig. 4 Selection Output Signal

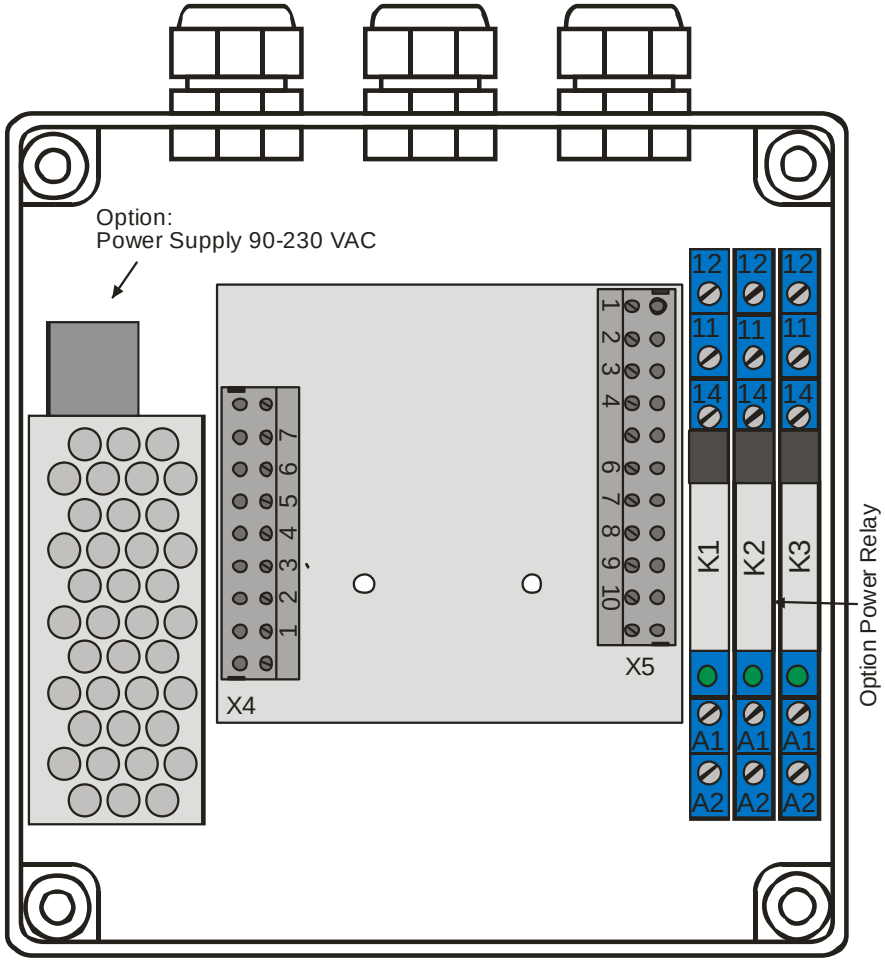

Fig. 5 Housing

5 Commissioning

5.1 Commissioning

Prior to commissioning, the wiring of the SPC-X3 including all field devices must be completely terminated!

Check the optional external transmitter input signal (current or voltage signal). It has to be the same as indicated on the label of the PCB. See fig. 3.

Select the contact for relay 2 with jumper NC/NO. See fig. 2 and 3.

Select the analog output signal with jumper V-A and 0-20%. See fig. 3 and 4.

After switching the power supply “ON” and at the end of the Power ON Time, the SPC-X3 is ready for use.

The SPC-X3 is delivered with standard parameters and set points for the on-board sensor (MP 01). These parameters have to be checked at commissioning and adjusted if necessary. If an additional external transmitter is connected, then you have to set the parameters for MP02 according to the intended application.

The standard parameters can be taken from the following configuration and parameter card. We recommend registering the individual parameters and set points into the list.

We recommend checking the parameters and set points according to the following check list.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

5.2 Checklist Commissioning

System Parameter

Parameter	Finished
Parameter of average function	
Password level 1 (customer's password)	
Function analog output	
Define fault relay	
Power ON time	
Service phone no.	
Maintenance date	

Relay Parameter

Parameter	Finished			
Relay R	1	2	3	4
Relay mode				
Function static / flash				
Latching mode				
Horn function				
External relay operation				
Delay ON time				
Delay OFF time				

MP Parameter

Parameter	Finished	
MP No. [1]	1	2
MP mode		
Gas type		
Measuring range		
MP signal		
Threshold 1		
Threshold 2		
Threshold 3		
Threshold 4		
Hysteresis		
Delay ON time		
Delay OFF time		
C/A mode		
Assigned failure <> alarm		
Assigned alarm <> alarm relay		
Assig. MP sig. <> analog output		

[1] MP 01 = On Board Sensor, MP 02 = external Transmitter

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

6 Configuration and Parameter Card

Commission:		Project No.		
Customer:				
Commissioning - Company				
Commissioning - Date		Service Technician		

6.1 Configuration Card of System Parameters

Service	Software Version	Maintenance due in x days	Service Phone	AV Overlay			Maintenance interval	Costumer Pass	Fault Relay	Power ON Time
				ppm	Time	AV Time				
Default	SPC 03	211	0853190040	120	120	1800	365	1234	0	30 s

Analog Output 1		
	Calibration	
Mode	= 4	= 20
Max.	4.0	20.0

6.2 Configuration Card of Alarm Relays

Relay No.	Mode	Static Flash	Latching Mode	Horn Function			External		Delay Time	
							ON	OFF	ON	OFF
				Time	Quitt	DI	DI	DI	DI	DI
Default	Energized	0 s	No	0	0	0	0	0	0	0
R01										
R02										
R03										
R04										

6.3 Configuration Card of Measuring Parameters

MP No.	MP Status	Gas Type	Measuring Range	MP Signal	Thresholds				Hyst
					A1	A2	A3	A4	
Default	Not active	TOX	1	Linear	0,5	0,8	1	1	0,2
01									
02									

Delay Time (sec.)		CV/ AV	Assigned MP Fault < >Alarm				Assigned Alarm <> Alarm Relay				AO
ON	OFF		A1	A2	A3	A4	A1	A2	A3	A4	
0	0	CV	1	1	0	0	R1	R2	R3	R4	0

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

7 Specifications SPC-X3

Electrical	
Power supply	18 – 28 VDC/AC, reverse polarity protected
Power consumption (without options)	100 mA, max. 2,5 VA
Analog output signal Selectable: Current / Voltage : Starting point 0 or 20%	(0) 4 – 20 mA, load ≤ 500 Ω (0) 2 – 10 V, load ≥ 50 kΩ Proportional, overload and short-circuit-proof
Alarm relay (R1)	30 VAC/DC, 0,5 A, potential-free, SPDT
Alarm relay (R2)	30 VAC/DC, 0,5 A, potential-free, SPNO/SPNC
Binary output (R3; R4)	30 VDC, 0,05 A open collector output
Visualization	
Display	Two lines, each 16 characters
Status LED (4)	Normal operation- Fault- Alarm 1- Alarm 2
Operation	4 push- buttons, menu-driven
Operation Environment	
Humidity	15 – 90 % RH non condensing
Working temperature	- 10° C to + 40° C (14 °F to 104 °F)
Storage temperature	5° C to + 30° C (41 °F to 86 °F)
Pressure range	Atmospheric ± 10 %
Physical	
Enclosure stainless steel, type 5	Stainless steel V2A
Colour	Natural, brushed
Dimensions (W x H x D)	113 x 135 x 45 mm (4.48 x 5.35 x 1.8 in.)
Weight	Approx. 0,6 kg (1.32 lbs.)
Protection class	IP 55
Installation	Wall mounting, pillar mounting
Cable entry	Standard 2 x M 20
Enclosure plastic version, type C	Plastics GWPLAST
Flammability	UL 94V2
Colour	RAL 7032 (light grey)
Dimensions (W x H x D)	130 x 130 x 75 mm (5.11 x 5.11 x 2.95 in.)
Weight	Approx. 0.6 kg (1.32 lbs.)
Protection	IP 65
Installation	Wall mounting
Cable entry	Standard 3 x M 20
Wire connection	Screw type terminals min. 0,25 to 2,5 mm^2 (14 to 30 AWG)
Guidelines	EMC Guidelines 2004/108//EEC CE
Warranty	1 year on material (without sensor)

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

Options

Analog input (external transmitter)	
Analog input (1)	4 – 20 mA, input resistance 200 Ω, (0) 2 – 10V, input resistance 25 kΩ, overload- and short-circuit-proof
Power supply for external analog transmitter	24 VDC max. 50 mA
Buzzer	
Acoustic pressure	85 dB (A) (distance 300 mm) (1 ft.)
Frequency	3500 Hz
LED flashlight red	
Flashing frequency	Adjustable
Luminosity	> 5.000 mcd
Power supply 90 - 230 VAC	
Consumption max.	25 VA
Power Relay (K1 – K3)	
Switch capacity	250 VAC, 5 A, potential-free, SPDT
Serial Interface	
Transceiver	RS 485 / 19200 Baud
Heating	
Temperature controlled	3 ± 2 °C (38 °F ± 3.6 °F)
Ambient temperature	-40 °C (-40 °F)
Power consumption	0.3 A; 7.5 VA
Duct mounting version	
Flow speed	5000 - 20.000 m/h (3 to 12 miles/h)
Duct diameter	ca. 200 – 1000 mm (8 – 40 inch.)

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

8 Gas Sensor

8.1 Description

The integrated sensor is a sealed electro-chemical cell with three electrodes, sensing, counter and reference. The ambient air to be monitored diffuses through a membrane filter into the liquid electrolyte of the sensor. The chemical process of the measurement is one of oxidation where one molecule of the target gas is exchanged for one molecule of oxygen. The reaction drives the oxygen molecule to the counter electrode, generating a microampere signal (mA) between the sensing and reference electrodes. This signal is linear to the volume concentration of the sensed gas. The signal is evaluated by the connected amplifier and transformed into a linear output signal.

Electrochemical processes always lead by-and-by to a loss of sensitivity. Typical life time for this sensor is approximately 2 years in normal operation. This will vary somewhat from sensor to sensor, with some working lifetimes less than 2 years and some more than 2 years. This wear also changes the characteristics of the sensor, requiring periodic re-calibration with the potentiometer Gain. It is recommended that the sensor accuracy be verified every twelve months and recalibrated as necessary.

8.2 Calibration

Required instruments to calibrate the transmitter:

- Test gas bottle with synthetic air (20 % O2, 80 % N) or CL_2-/CLO_2 free ambient air.
- Test gas bottle with CL_2 1 ppm. Rest is synthetic air.
- Gas pressure regulator with flow meter to control the gas flow to 150 ml/min.
- Calibration adapter with tube. Type: Calibr-set-AT 1110C01 See fig. 06
- Small screwdriver.

Note: Please observe proper handling procedures for test gas bottles!

8.2.1 Zero-Point Calibration

Consider the running-in period of the sensor (at least 18 hour).

- Open window MP 01 in menu “Measuring Value”.
- Connect calibration adapter carefully to the sensor element.
- Apply synthetic air (150 ml/min; 1 Bar (14.5 psi) ± 10%), or CL_2 /CLO_2 free ambient air.
- Wait 1 minute until the measuring signal at MP 01 is stable, push button “Zero” for 8 seconds.

  After successful calibration the measuring signal is corrected automatically.

  If the zero-point is out of the admissible range (> 10 % of measuring range) before calibration, there is no correction of the measuring signal. The sensor has to be replaced.
- Remove calibration adapter carefully by turning lightly. Check the sensor for correct mounting!

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

8.2.2 Gain Calibration

Notes:

CL_2 calibration gas is toxic, never inhale the gas!
Symptoms: Dizziness, headache and nausea.
Procedure if exposed: Take the victim into fresh air at once, call a doctor.

- Open window MP 01 in menu “Measuring Value”.
- Connect calibration adapter carefully to the sensor element.
- Apply calibration test gas CL_2 (150 ml/min; 1 Bar (14.5 psi) ± 10%).
- Wait three minutes until the measuring value is stable, adjust the value with potentiometer ”Gain” until the value corresponds to the Calibration gas concentration. The sensor has a cross-sensitivity of 0.6 compared to Cl_2. At 1 ppm Cl_2 calibration therefore is the display value at 0.6 ppm (CLO_2)
- Remove calibration adapter with a careful light turn. Check the sensor for correct mounting!

  By limiting the gain factor, calibration will not be possible any more when the sensitivity of the sensor reaches a residual sensitivity of 30%. Then the sensor has to be replaces.

9 Inspection and Service

Inspection, service and calibration of the SPCX3 should be done by trained technicians and executed at regular intervals. We therefore recommend concluding a service contract with MSR or one of their authorized partners.

According to EN 45544-4, inspection and service has to be executed at regular intervals. The maximum intervals have to be determined by the person responsible for the gas warning system according to the legal requirements. MSR-E recommends checking the PolyGard Transmitter every three months and maintaining it every 12 months. If different intervals are indicated, always consider the shortest interval.

Inspections and services must be documented. The date for the next maintenance has to be affixed to the transmitter.

9.1 Inspection

The PolyGard SPCX3 should be controlled regularly by a competent person according to EN 45544-4. The following has to be checked in particular:

- Maintenance/ calibration interval not exceeded.
- Visual inspection of the transmitter including cable for damage etc.
- Remove dust deposits, especially at the gas inlet.
- The filter at the gas inlet has to be replaced if extremely dirty.
- Check the function of alarm relays.

9.2 Service and Calibration

When performing the maintenance you have to do the calibration and the functional test in addition to the inspection.

- Calibration: See section 8.
- Functional test: Check the output signal at the test pins during calibration.

9.3 Exchange of Sensor Element

Consider static electricity! See point 3.
Sensor should always be installed without power applied:

- Unplug old sensor element from the PCB.
- Take the new sensor out of the original packing.
- Plug in the sensor element into the PCB at X3/X7.
- Calibrate according to section 8.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

10 Specification Gas Sensor

Sensor performances		
Gas type	Chlorinedioxide (CLO_2)	
Sensor element	Electrochemical, diffusion	
Measuring range	0 - 1 ppm	
Pressure range	Atmosphere ± 15 %	
Storage temperature range	5 °C to 30 °C (41 °F to 86 °F)	
Storage time	Max. 3 months	
Mounting height	0.2 m (0,7 ft.)	
Accuracy	± 0,03 ppm	
Repeatability	± 2 % of reading	
Long-term drift output signal	< 10% signal loss/1 months	
Response time	t_{90} < 120 sec.	
Life expectancy	> 2 years/normal operating environment	
Humidity range – short-term	15 – 90 % RH non condensing	
Temperature range - continuous	-10 °C to + 45 °C (14 °F to 113 °F)	
Cross sensitivity*	Concentration (ppm)	Reaction (ppm)
Chlorine	1	0,6
Carbon monoxide CO	100	0
Ozone, O_3	0,25	0,7
Hydrogen Sulfide, H_2S	20	-0,5
Hydrogen, H_2	3000	0

Calibration adapter
Fig. 6
Type: Calibr-set-AT 1110C01

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany

11 Part Disposal

Since August 2005 there are EC-wide directives defined in the EC Directive 2002/96/EC and in national codes concerning the waste electrical and electronic equipment and also regarding this device.

For private households there are special collecting and recycling possibilities. For this device isn't registered for the use in private households, it mustn't be disposed this way. You can send it back to your national sales organisation for disposal. If there are any questions concerning disposal please contact your national sales organisation.

Outside the EC, you have to consider the corresponding directives.

12 Notes and General Information

It is important to read this user manual carefully in order to understand the information and instructions. The PolyGard® SPC-X3 gas monitoring, control and alarm system may only be used for applications in accordance to the intended use. The appropriate operating and maintenance instructions and recommendations must be followed.

Due to permanent product developments, MSR reserves the right to change specifications without notice. The information contained herein is based on data considered to be accurate. However, no guarantee or warranty is expressed or implied concerning the accuracy of these data.

12.1 Intended Product Application

The PolyGard® SPC-X3 is designed and manufactured for controlling, for saving energy and keeping OSHA air quality in commercial buildings and manufacturing plants (i.e. detection and automatic exhaust fan control for automotive maintenance facilities, enclosed parking garages, engine repair shops, warehouses with forklifts, fire stations, tunnels, etc.).

12.2 Installers` Responsibilities

It is the installer's responsibility to ensure that all PolyGard® SPC-X3 are installed in compliance with all national and local regulations and OSHA requirements. All installations shall be executed only by technicians familiar with proper installation techniques and with codes, standards and proper safety procedures for control installations and the latest edition of the National Electrical Code (ANSI/NFPA70). It is also essential to follow strictly all instructions as provided in the user manual.

12.3 Maintenance

We recommended checking the PolyGard® SPC-X3 system regularly. Due to regular maintenance differences in efficiency can easily be corrected. Limited Warranty Re-calibration and part replacement may be implemented in the field by a qualified technician and with the appropriate tools. Alternatively, the easily removable plug-in transmitter card with the sensor may be returned for service to MSR-Electronic-GmbH.

12.4 Limited Warranty

MSR warrants the PolyGard® SPC-X3 against defects in material or workmanship for a period of one (1) year beginning from the date of shipment. Should any evidence of defects in material or workmanship occur during the warranty period, MSR will repair or replace the product at their own discretion, without charge.

This warranty does not apply to units that have been altered, had attempted repair, or been subjected to abuse, accidental or otherwise. The above warranty is in lieu of all other express warranties, obligations or liabilities.

This warranty applies only to the PolyGard® SPC-X3. MSR shall not be liable for any incidental or consequential damages arising out of or related to the use of the PolyGard® SPC-X3.

Phone: 0049(0)8531/9004-0 Fax: 0049(0)8531/9004-54
MSR-Electronic GmbH, Würdinger Str. 27, D 94060 Pocking www.msr-electronic.de

Specification subject to change without notice.
Printed in Germany